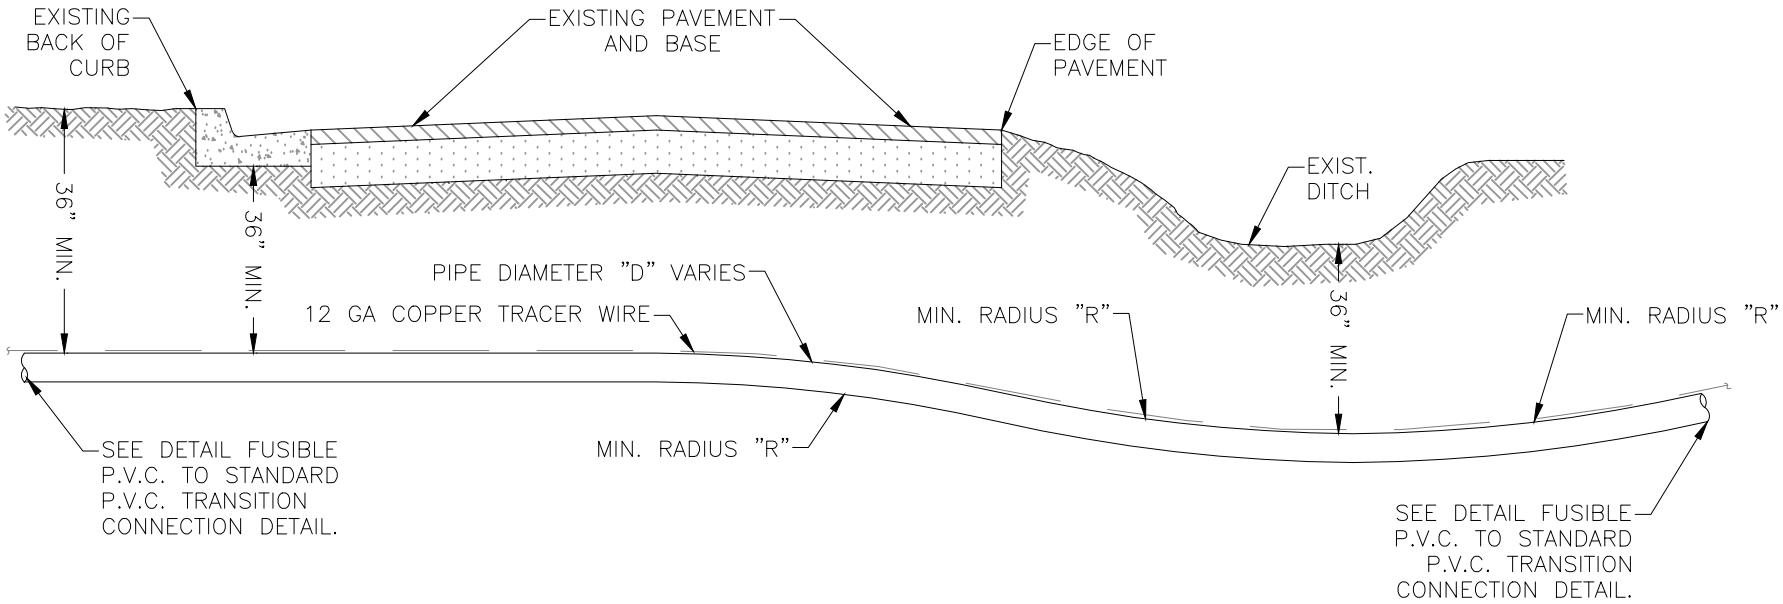

	MIN. RADIUS FOR FUSIBLE PVC PIPE IN FEET
PIPE DIAMETER "D" IN INCHES	MIN. RADIUS "R" FUSIBLE PVC FOR DR-18
2	XX
3	73
4	100
6	144
8	189
10	231
12	275
16	363
18	406
20	450

1.) ALL PIPE MUST BE C900/C905.

2.) THE COLOR CODING SHALL MEETING REQUIREMENTS IN ACCORDANCE WITH SUBPARAGRAPH 62-555.320 (21)(B) 3 F.A.C. AND SHALL BE CO-EXTRUDED DURING PIPE MANUFACTURING.

3.) PIPE ROLLERS SHALL BE PROVIDED AS REQUIRED BY SPECIFICATIONS TO SUPPORT PIPE AND PROTECT PIPE FROM SCRATCHES AND GOUGES.

4.) ALL DIRECTIONAL BORES SHALL BE A MINIMUM OF 36 INCHES UNDER ALL ROADWAYS AND START AND TERMINATE A MINIMUM OF 6 FEET OFF THE EDGE OF PAVEMENT.

5.) CONTRACTOR SHALL PROVIDE A DETAILED "AS-BUILT" PROFILE OF ALL DIRECTIONAL BORE AND JACK AND BORE LOCATION OF ACTUAL PIPE ELEVATIONS AT 10 FOOT INTERVALS ON AS-BUILT PLAN SHEETS.

CITY OF P.C.B.
UTILITIES DEPARTMENT

REV.	DATE
1	MAR '12

DATE OF APPROVAL

DIRECTIONAL BORE
FUSIBLE P.V.C. MINIMUM
RADIUS DETAIL

M-19