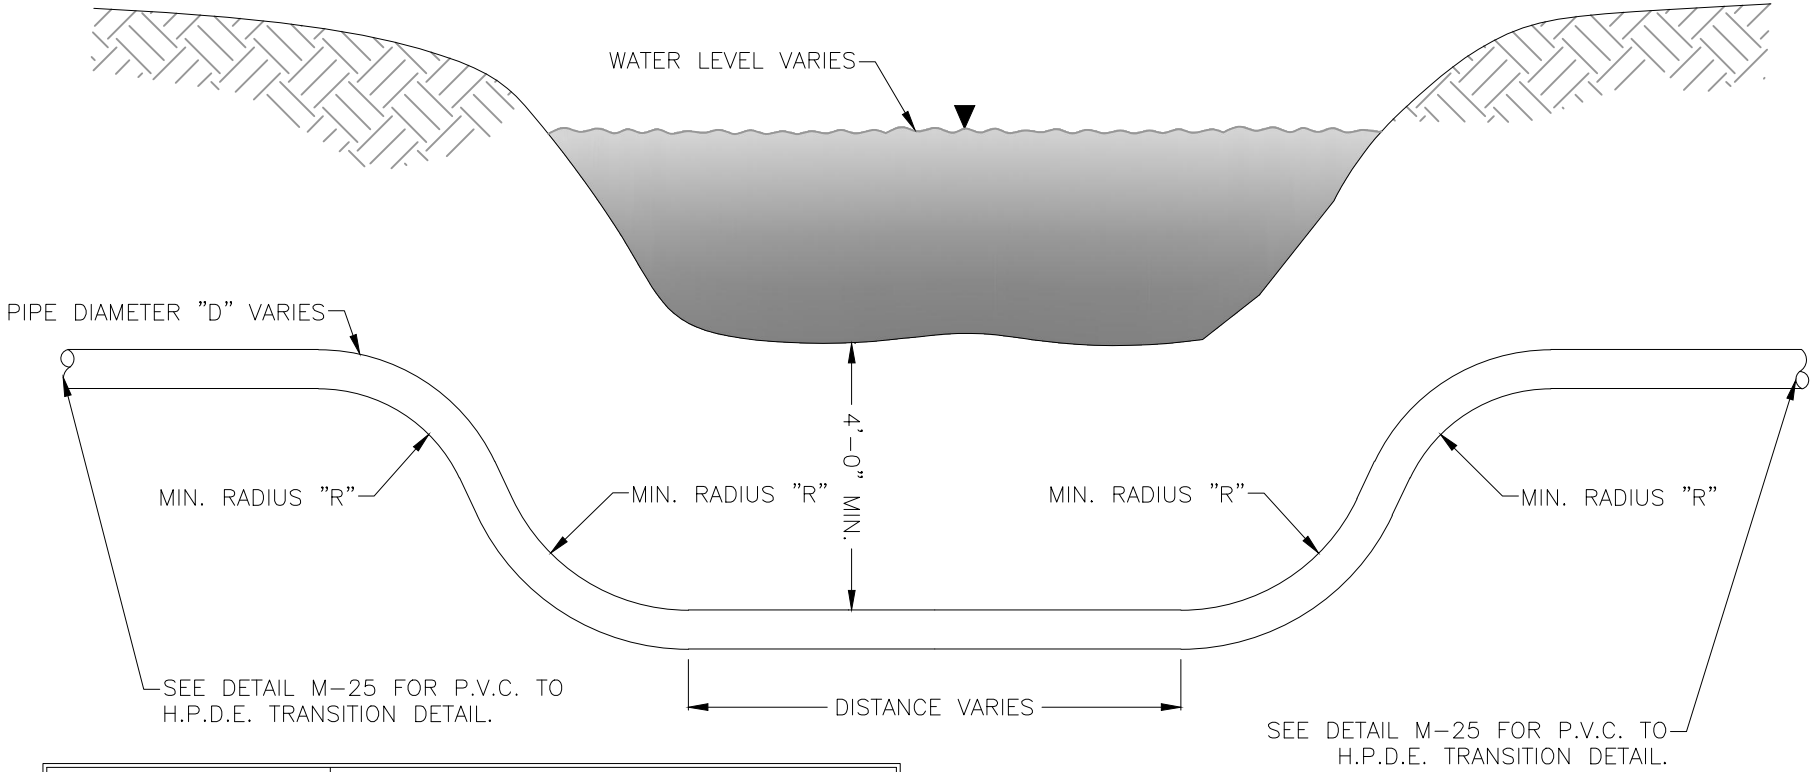

	MIN. RADIUS FOR PE PIPE IN FEET	
PIPE DIAMETER "D" IN INCHES	MIN. RADIUS "R" FOR SDR-11	MIN. RADIUS "R" FOR SDR-9
1	2	2
2	4	4
3	6	5
4	8	7
6	12	10
8	17	14
10	21	17
12	25	20
16	33	27
18	38	30
20	42	34

NOTE:

ALL POLYETHYLENE PIPING SHALL MEET CITY OF PANAMA CITY BEACH STANDARDS AND SPECIFICATIONS:

SDR-9, CLASS 200 FOR POTABLE WATER & RECLAIMED WATER
SDR-11, CLASS 160 FOR SANITARY FORCE MAINS
COLOR CODED BLUE FOR POTABLE WATER
COLOR CODED PURPLE FOR RECLAIMED WATER
COLOR CODED GREEN FOR SANITARY FORCE MAIN

CITY OF P.C.B.
UTILITIES DEPARTMENT

REV.	DATE
1	MAR '12

DATE OF APPROVAL

DIRECTIONAL BORE CANAL CROSSING

M-20