




PLAN

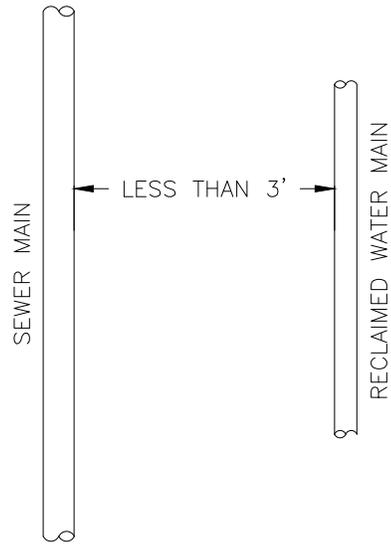

PLAN

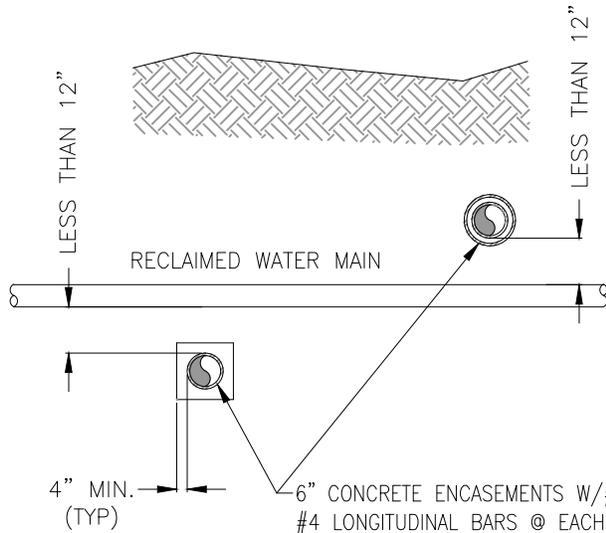

SECTION

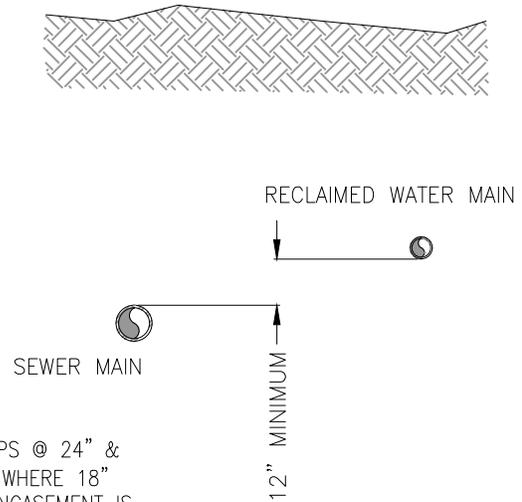

SECTION

6" CONCRETE ENCASEMENTS W/#3 STIRRUPS @ 24" & #4 LONGITUDINAL BARS @ EACH CORNER. WHERE 18" CLEARANCE IS UNATTAINABLE, CONCRETE ENCASEMENT IS TO BE USED. SUBJECT TO APPROVAL BY F.D.E.P. AND THE CITY OF PANAMA CITY BEACH PUBLIC WORKS CONCRETE STRENGTH SHALL BE 2500 P.S.I. (MIN)

CITY OF P.C.B.
UTILITIES DEPARTMENT

TYPICAL RECLAIMED
WATER/SEWER CROSSING

R-3B

REV.	DATE
1	MAR '12

.....
DATE OF APPROVAL