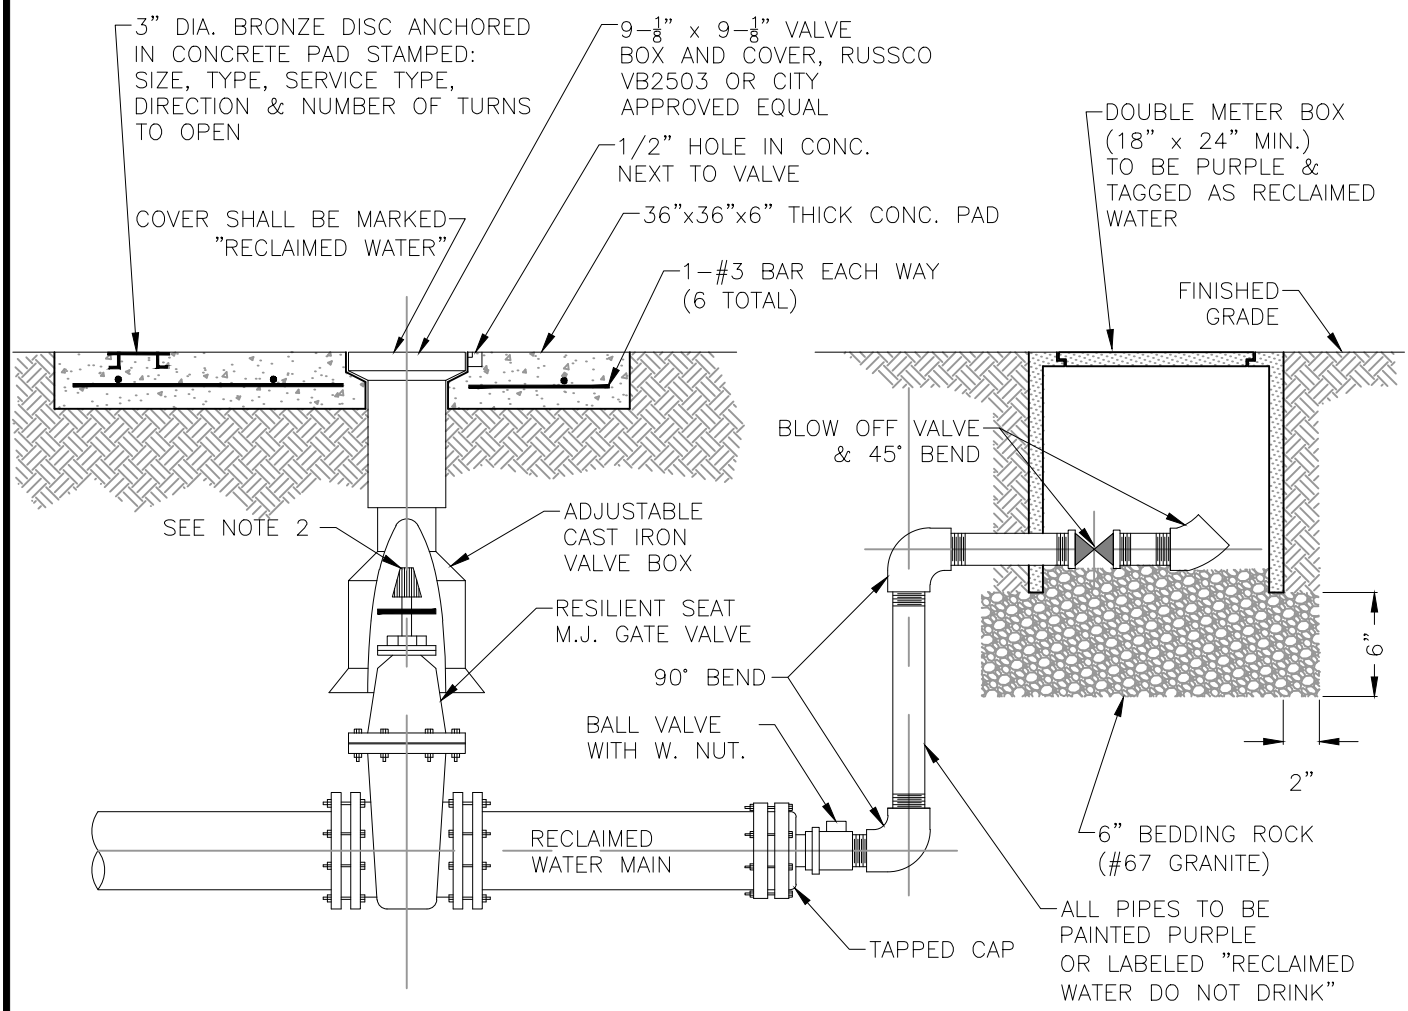

NOTES:

1.) PVC EXTENSIONS SHALL NOT BE USED ON VALVE BOX INSTALLATION.

2.) THE ACTUATING NUT FOR DEEPER VALVES SHALL BE EXTENDED TO COME UP TO 4 FOOT DEPTH BELOW FINISHED GRADE.

CITY OF P.C.B. UTILITIES DEPARTMENT			END OF LINE 4" AND LARGER BLOW-OFF ASSEMBLY	R-4B
REV.	DATE			
1	MAR '12			
		..... DATE OF APPROVAL		

I:\CAD\AutoCad Files\0-UTILITIES DEPARTMENT\UTILITY MAPS\DETAILS_PCB-MOST CURRENT\0-DWG\0-NEW-PCB-UTL-DETAILS-1.dwg, 6/11/2014 1:46:31 PM, 24x36monoserv.ctb