



STANDARD DROP DETAIL

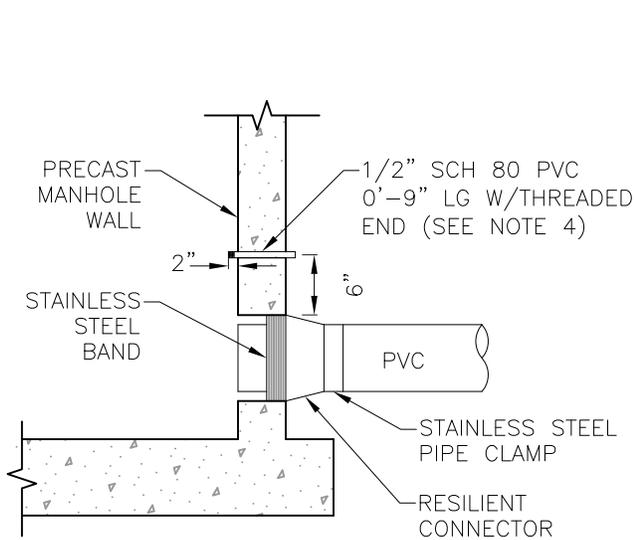

STANDARD PRECAST MANHOLE PIPE CONNECTION

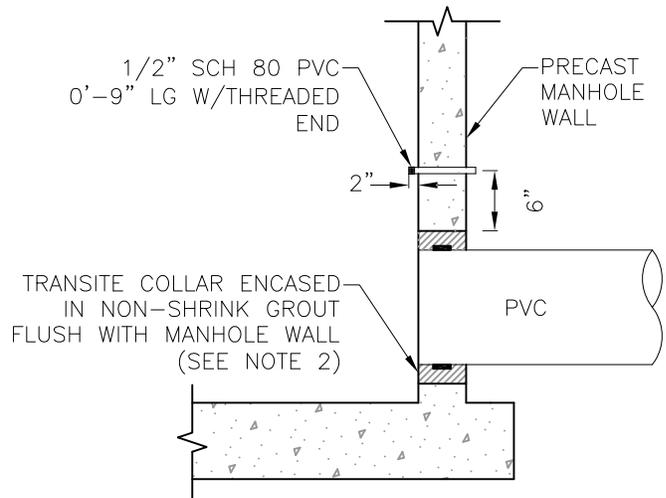

SPECIAL DETAIL FOR 24" DIAMETER PIPE AND LARGER

NOTES:

- 1.) DROP PIPE AND FITTINGS SHALL BE OF EQUAL SIZE AND MATERIAL AS THE INFLUENT SEWER.
- 2.) THE CITY MAY APPROVE ALTERNATE WATER TIGHT CONNECTION DETAILS FOR CONNECTION OF 24" DIAMETER PIPES AND LARGER.
- 3.) AN OUTSIDE DROP CONNECTION SHALL BE REQUIRED FOR ALL INFLUENT WHICH HAVE AN INVERT 2' OR MORE ABOVE THE MANHOLE INVERT.
- 4.) 1/2" SCH 80 PVC PIPE IS INTENDED FOR PRESSURE TESTING OF GRAVITY SEWER MAINS.

CITY OF P.C.B.
UTILITIES DEPARTMENT

REV.	DATE
1	MAR '12

.....
DATE OF APPROVAL

MANHOLE
CONNECTION DETAILS

S-3