



**PLAN**

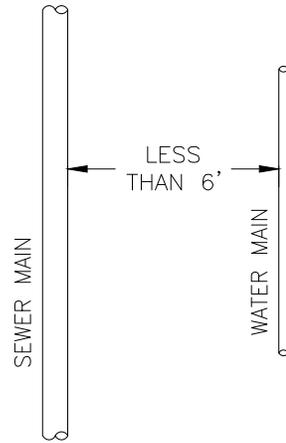

**PLAN**

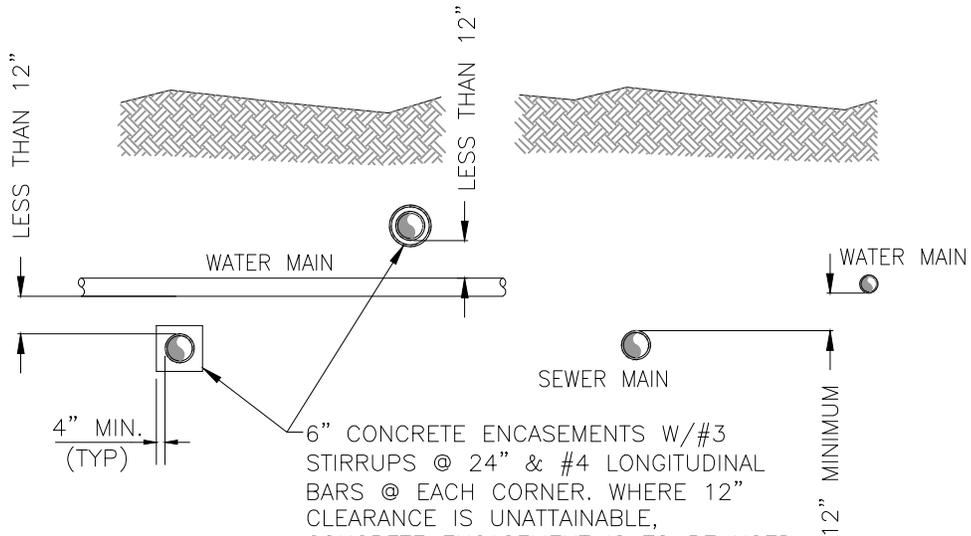

**SECTION**

**SECTION**

6" CONCRETE ENCASEMENTS W/#3 STIRRUPS @ 24" & #4 LONGITUDINAL BARS @ EACH CORNER. WHERE 12" CLEARANCE IS UNATTAINABLE, CONCRETE ENCASEMENT IS TO BE USED. SUBJECT TO APPROVAL BY F.D.E.P. AND THE CITY OF PANAMA CITY BEACH PUBLIC WORKS CONCRETE STRENGTH SHALL BE 2500 P.S.I. (MIN)

CITY OF P.C.B.  
UTILITIES DEPARTMENT

WATER & SEWER  
MAIN CROSSING/  
SEPARATION DETAIL

S-6A

REV.	DATE
1	MAR '12

.....  
DATE OF APPROVAL