
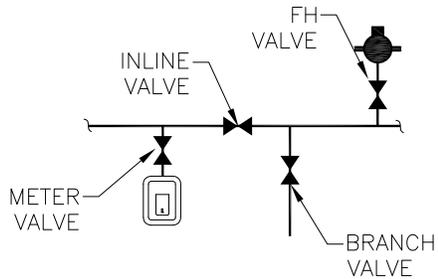


3" DIA. BRONZE DISC ANCHORED IN CONCRETE PAD AS REQUIRED.
 SIZE OF VALVE
 TYPE OF VALVE/
 BRANCH, INLINE,
 FIRE HYDRANT, METER
 TYPE OF SERVICE
 DIRECTION & NUMBER
 OF TURNS TO OPEN




2,500 P.S.I.
 CONCRETE MIN.
 #3 REBAR
 (6 TOTAL)

VALVE BOX AND
 COVER (TYP.)

*36" x 6"
 THICK CONCRETE
 PAD TYPICAL EACH
 VALVE BOX

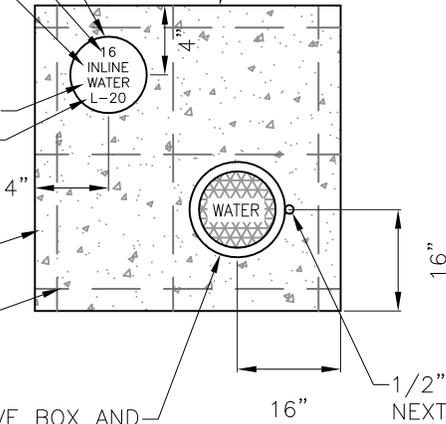

3" DIA. BRONZE
 DISC ANCHORED IN
 CONC. PAD STAMP
 AS REQUIRED

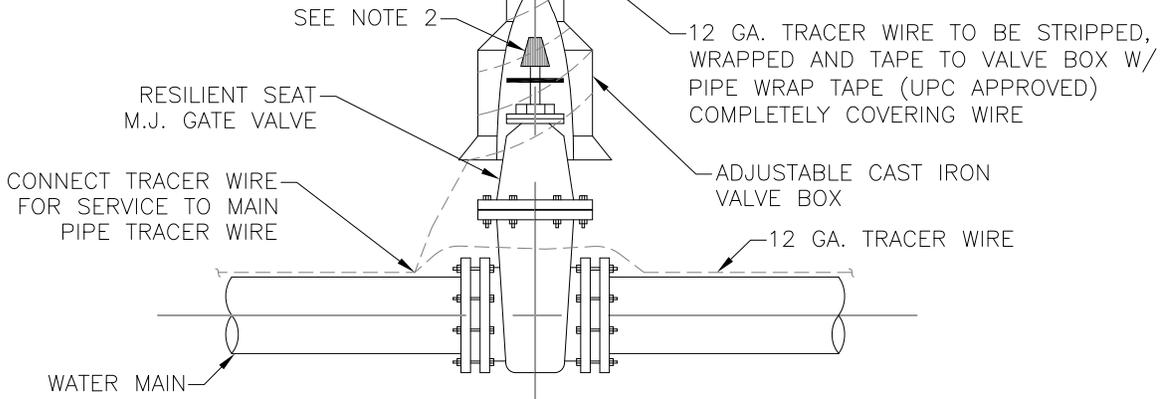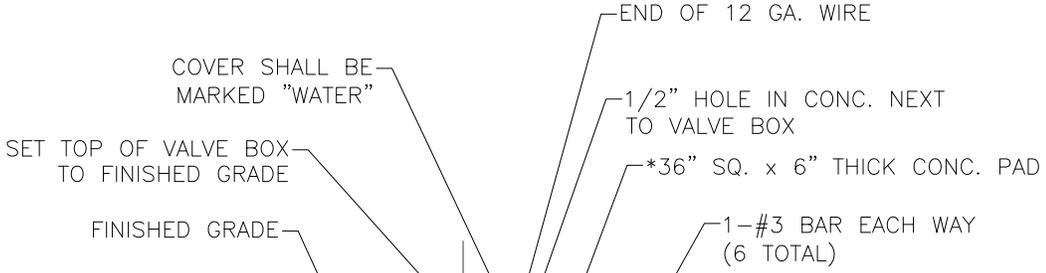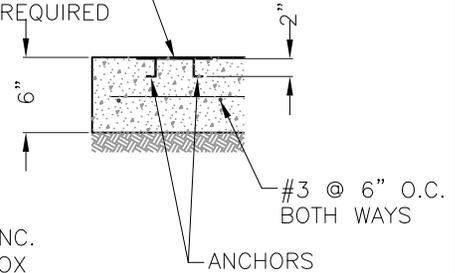

NOTES:

- 1.) PVC EXTENSIONS SHALL NOT BE USED ON VALVE BOX INSTALLATION.
- 2.) THE ACTUATING NUT FOR DEEPER VALVES SHALL BE EXTENDED TO COME UP TO 4 FOOT DEPTH BELOW FINISHED GRADE.

*NOTE: 24" SQ. PAD TO BE CONSTRUCTED INSIDE RESIDENTIAL AREAS.

CITY OF P.C.B.
 UTILITIES DEPARTMENT

GATE VALVE DETAIL
 4" TO 16"

W-1

REV.	DATE
1	MAR '12

.....
 DATE OF APPROVAL