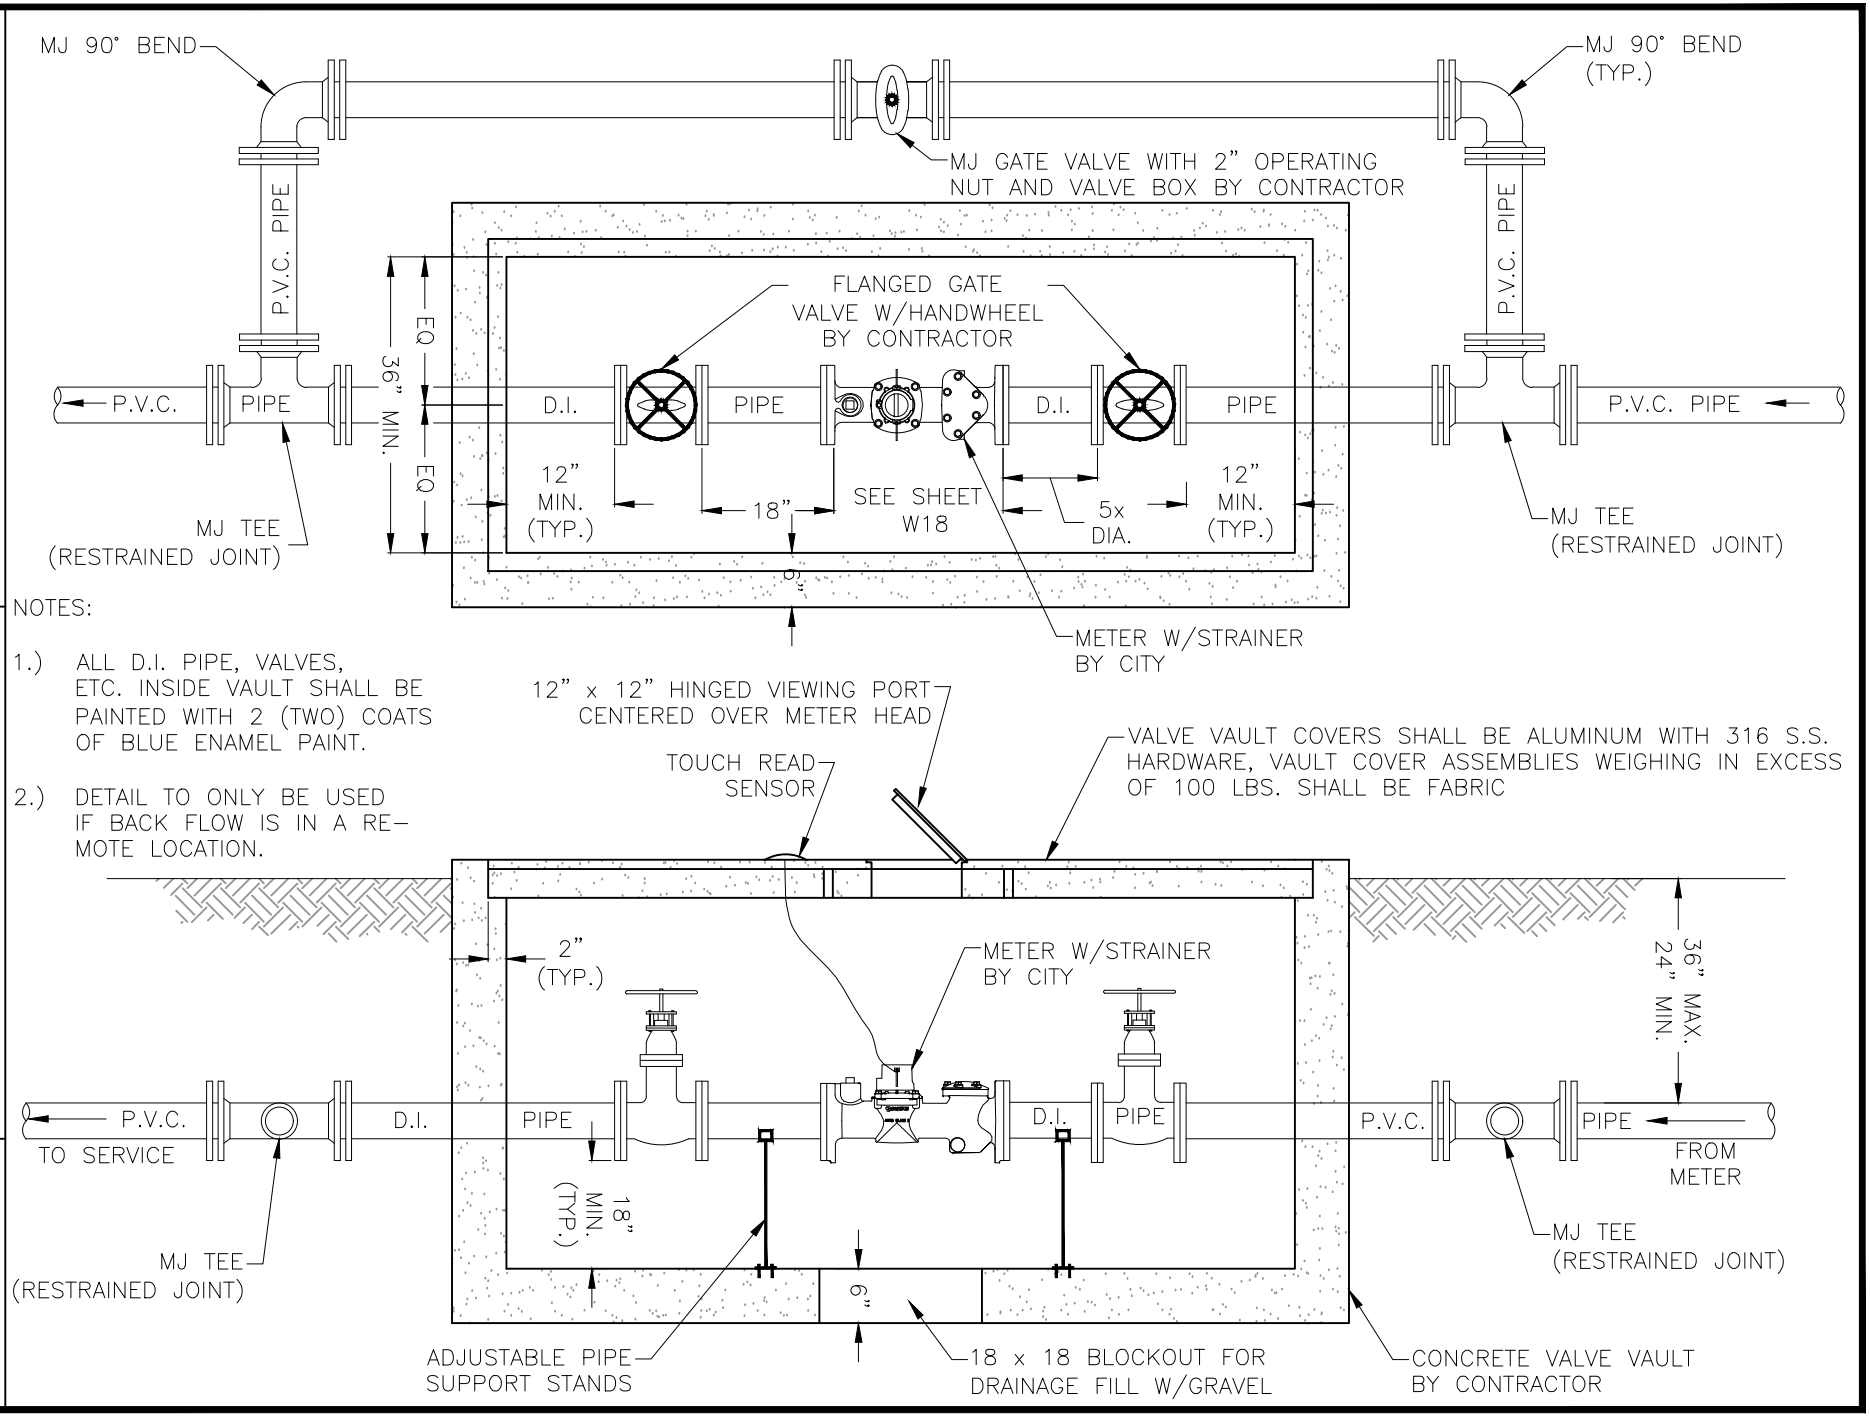

NOTES:

1.) ALL D.I. PIPE, VALVES, ETC. INSIDE VAULT SHALL BE PAINTED WITH 2 (TWO) COATS OF BLUE ENAMEL PAINT.

2.) DETAIL TO ONLY BE USED IF BACK FLOW IS IN A REMOTE LOCATION.

REV.	DATE
1	MAR '12

CITY OF P.C.B.
UTILITIES DEPARTMENT

DATE OF APPROVAL

3", 4" AND 6" WATER METER DETAIL W/ BYPASS

(BACK FLOW PREVENTER IN REMOTE LOCATION)

W-7