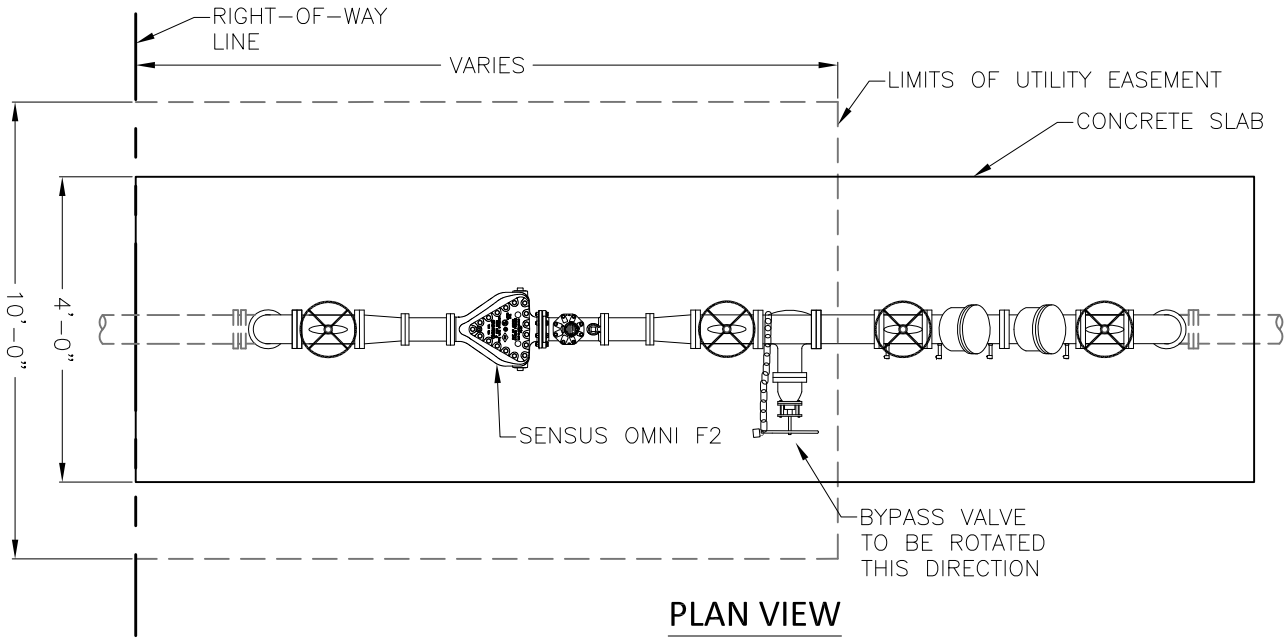

PLAN VIEW

NOTES:

1.) METER WILL BE PROVIDED BY THE CITY, AND INSTALLED BY CONTRACTOR.
2.) ALL ABOVE GROUND PIPE AND FITTINGS SHALL BE FLANGED DUCTILE IRON.
3.) PROVIDE PROTECTION AGAINST FREEZING FOR ALL ABOVE GROUND PIPE.
4.) ALL ITEMS ABOVE GRADE SHALL HAVE ONE COAT OF APPROVED EPOXY RED ENAMEL PAINT.
5). ALL ABOVE GROUND VALVES SHALL HAVE HANDWHEELS.
6.) BACK FLOW DEVICE SHALL BE AS APPROVED BY CITY.

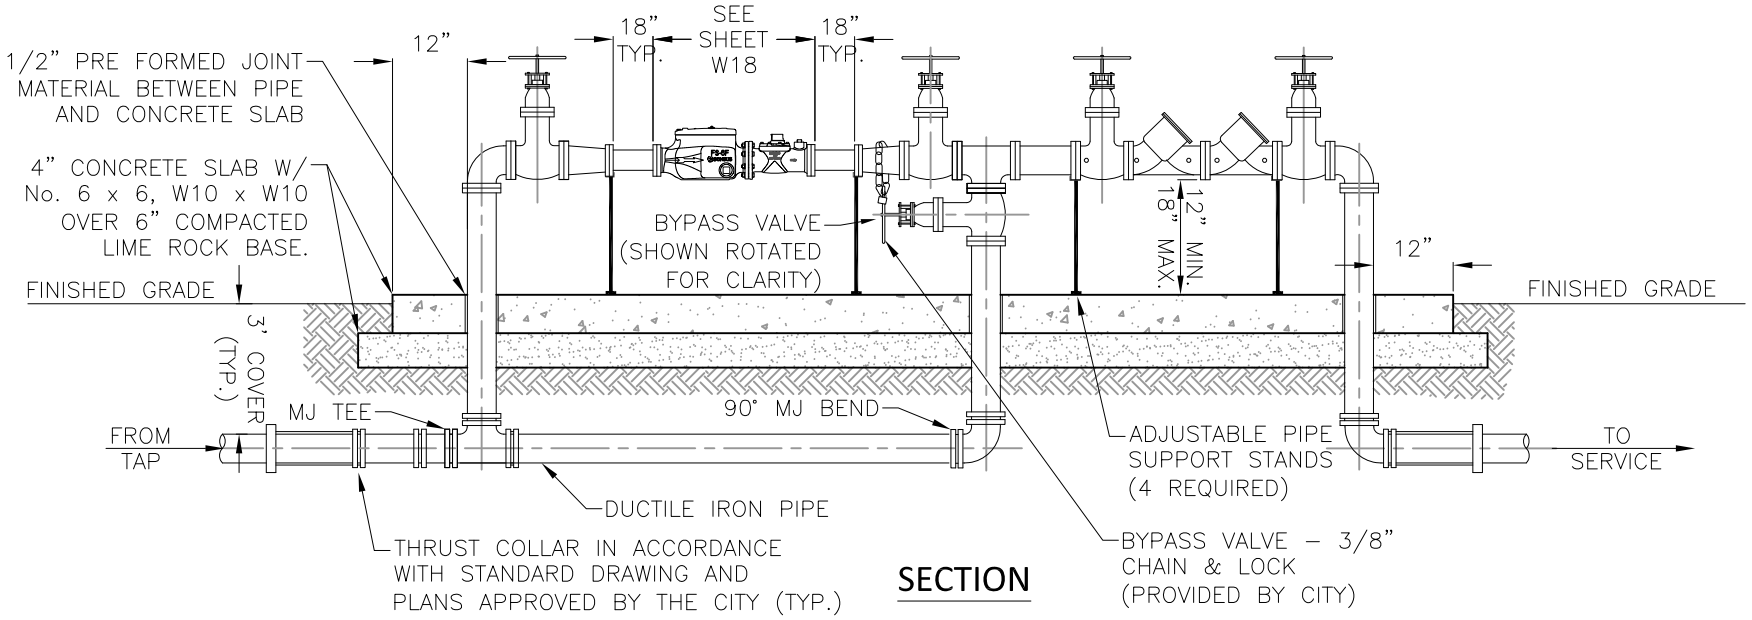

SECTION

CITY OF P.C.B.
UTILITIES DEPARTMENT

REV.	DATE
1	MAR '12
2	FEB '16

DATE OF APPROVAL

FIRE LINE MASTER METER ASSEMBLY DETAIL

W-10