


PLAN VIEW

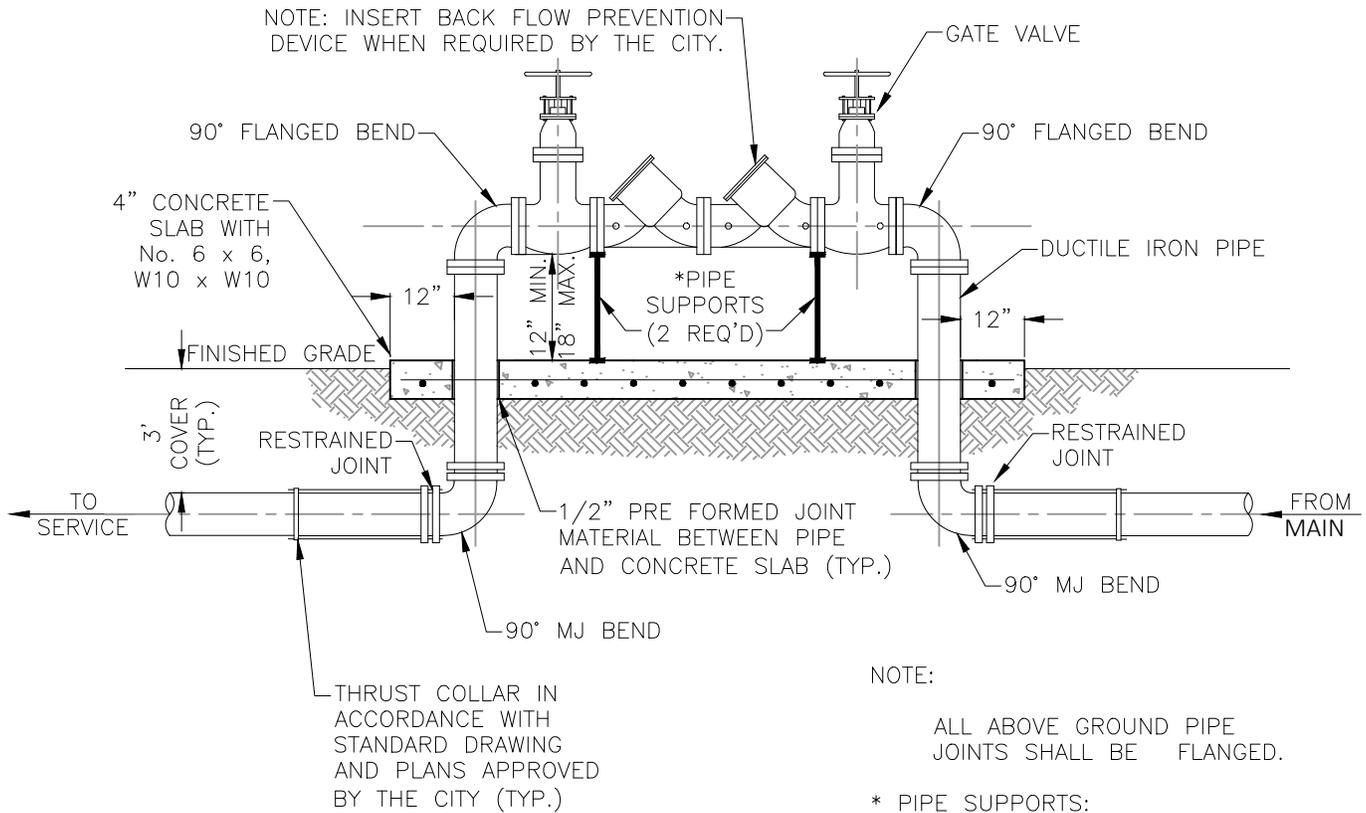

SECTION

NOTE:

ALL ABOVE GROUND PIPE JOINTS SHALL BE FLANGED.

* PIPE SUPPORTS:

- 1 REQ'D UNDER CENTER FOR 6",
- 2 REQ'D FOR 8" AND LARGER

CITY OF P.C.B.
UTILITIES DEPARTMENT

DOUBLE DETECTOR
CHECK VALVE
ASSEMBLY DETAIL

W-17

REV.	DATE
1	MAR '12

.....
DATE OF APPROVAL