NOTES:

1.) ALL FITTINGS SHALL BE BRASS WITH COMPRESSION/PACK JOINT TYPE CONNECTIONS.

2.) NO SERVICE LINE SHALL TERMINATE UNDER A DRIVEWAY.

3.) TAPPING SADDLE: SHALL BE MODEL FC202 FORD METER BOX CO., INC. WITH EPOXY GATED BODY (NSF 61) AND 304 SS BAND AND HARDWARE. ALL OUTLETS SHALL BE IRON PIPE THREAD.

4.) ALL SERVICE TAPS TO BE LOCATED IN FIELD. TAPS SHALL BE NO CLOSER THAN 36" APART AND NOT WITHIN 24" FROM BACK OF PIPE BELL OR SPIGOT INSERTION LINE.

5.) TAPS SHALL NOT BE SET IN DRAINAGE SWALES, EASEMENTS, OR SIDEWALKS.

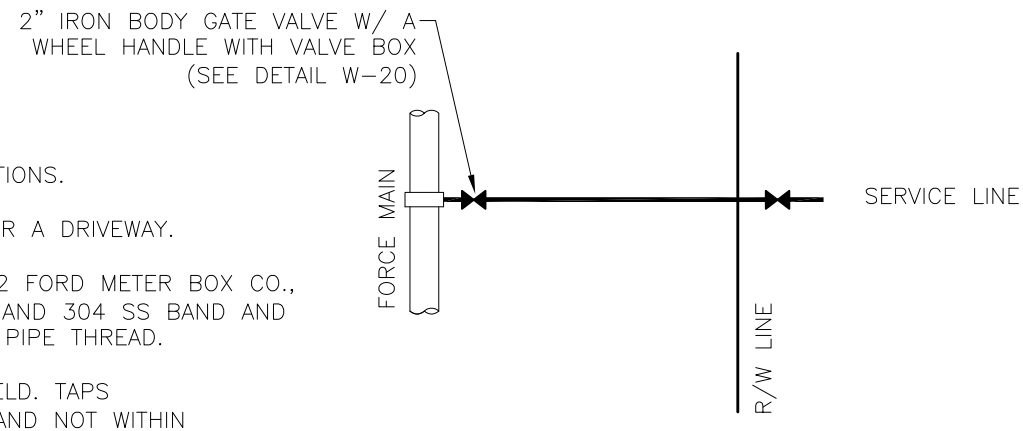

TYPICAL CITY SERVICE

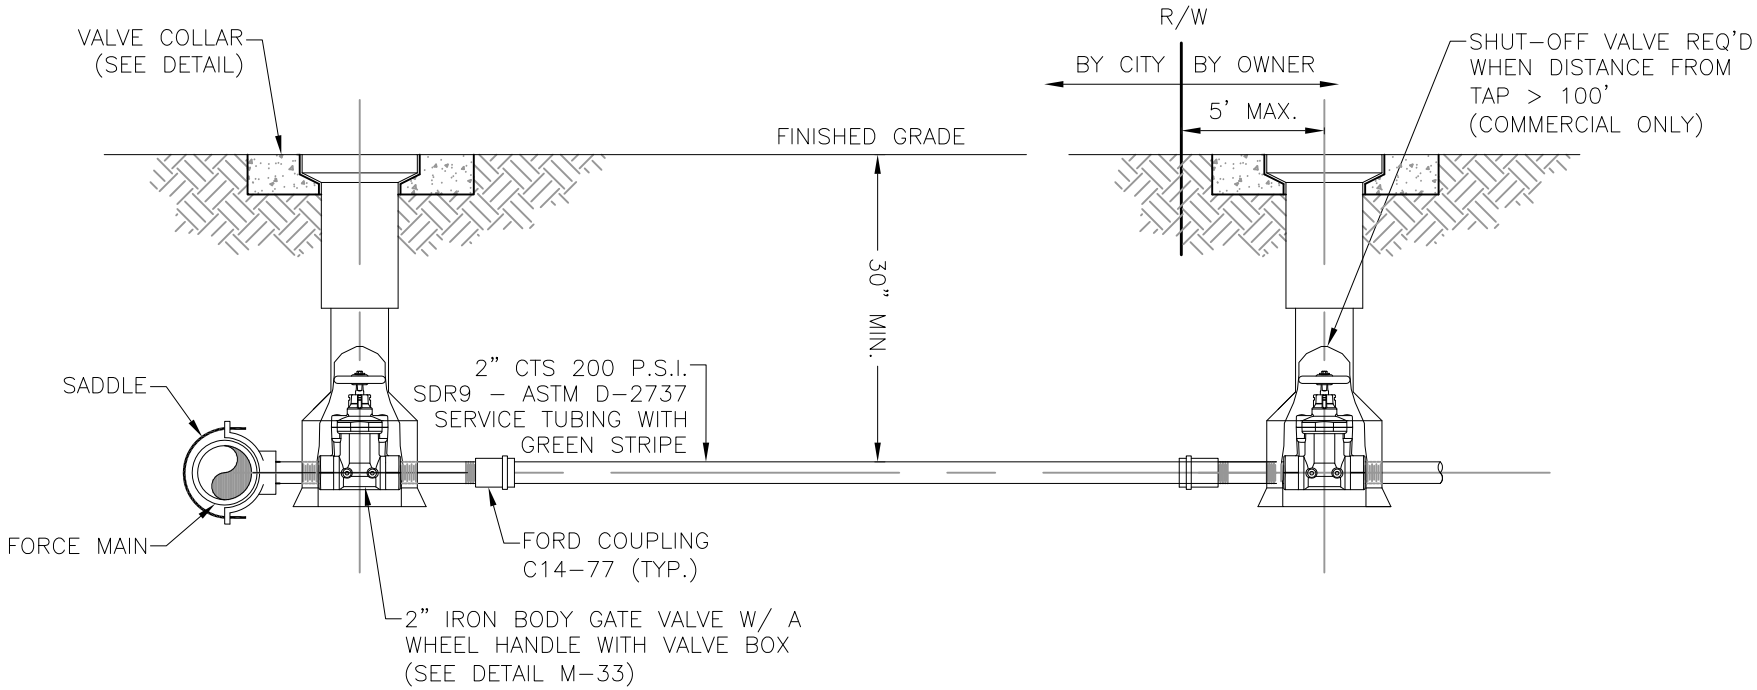

CITY OF P.C.B.
UTILITIES DEPARTMENT

REV.	DATE
1	DEC '15
2	JUL '16

DATE OF APPROVAL

GRINDER PUMP SERVICE DETAIL

S-19