


NOTES:

- 1.) USE OF TYPE A-2 AND A-3 PIPE BEDDING TO BE DETERMINED IN THE FIELD BY THE ENGINEER.
- 2.) 10" MAX. FOR PIPE DIAMETER LESS THAN 24"; 12" MAX. FOR PIPE DIAMETER 24" AND LESS THAN 42"; 24" MAX. FOR PIPE DIAMETER 42" AND OVER.
- 3.) 4" MAX. FOR PIPE 16" DIAMETER & LESS; 6" MAX. FOR PIPE 18" TO 36" DIAMETER; AND 9" MAX. FOR PIPE 42" DIAMETER AND LARGER.
- 4.) INSTALLATION SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS.
- 5.) THICKNESS TO MATCH EXISTING OR BE 4" MINIMUM, WHICHEVER IS GREATER.
- 6.) THICKNESS TO MATCH EXISTING OR BE 8" MINIMUM, WHICHEVER IS GREATER.
- 7.) IF ANY PART OF REQUIRED SAWCUT REMOVAL COMES WITHIN 3 FT. OF EXISTING JOINT ON EITHER SIDE OF TRENCH, REMOVE AND REPLACE TO EXISTING JOINT.
- 8.) SHEETING ORDERED LEFT IN PLACE TO BE CUT OFF 24" BELOW FINISHED GRADE OR 12" BELOW SUBGRADE.

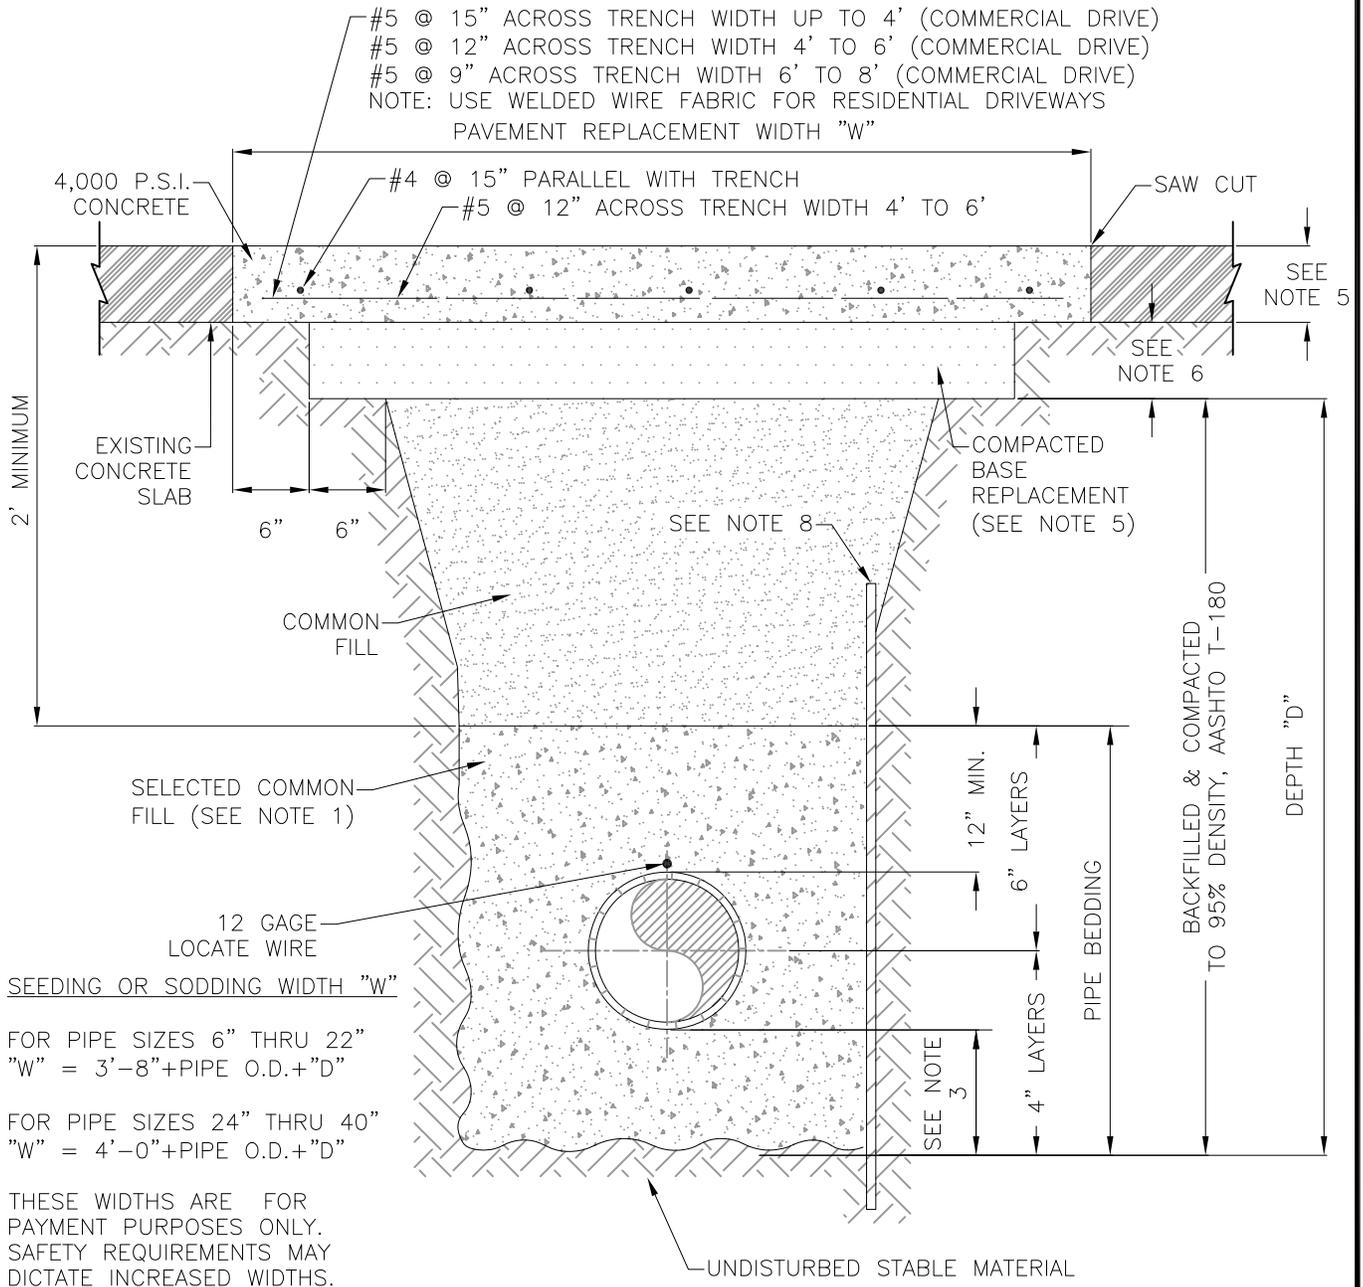

CITY OF P.C.B.
 UTILITIES DEPARTMENT

TRENCH DETAIL
 CONC. PAVEMENT SURFACE
 TYPE A-1 PIPE BEDDING

M-24

REV.	DATE
1	MAR '12
2	NOV '16

.....
 DATE OF APPROVAL