


NOTES:

- 1.) 10" MAX. FOR PIPE DIAMETER LESS THAN 24"; 12" MAX. FOR PIPE DIAMETER 24" AND LESS THAN 42"; 24" MAX. FOR PIPE DIAMETER 42" AND OVER.
- 2.) 4" MAX. FOR PIPE 16" DIAMETER AND LESS; 6" MAX. FOR PIPE DIAMETER 18" TO 36" AND 9" MAX. FOR PIPE DIAMETER 42" AND OVER.
- 3.) INSTALLATION SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS.

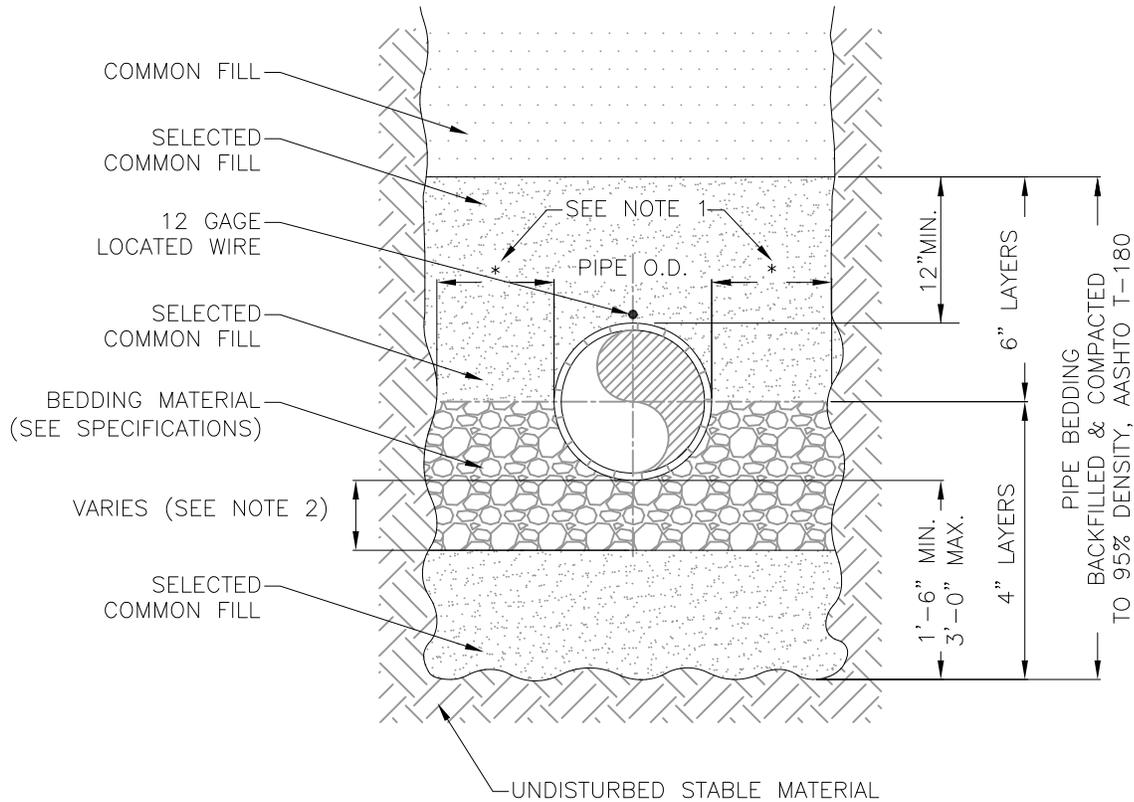

I:\L-PCB-UTL-BASE-MAP\details for email\CAD DETAILS BY SHEET\ALL.dwg, 11/30/2016 3:10:05 PM, 24x36monosurv.ctb

CITY OF P.C.B. UTILITIES DEPARTMENT		TRENCH DETAIL TYPE A-3 PIPE BEDDING	M-26
REV.	DATE	..... _____ DATE OF APPROVAL	
1	MAR '12		
2	NOV '16		